



Energy research Centre of the Netherlands

## **Electric vehicles and heat pumps providing flexibility to facilitate integration of large amounts of intermittent renewables**

IEA DSM Agreement Task XVII workshop July 9<sup>th</sup>, Petten, The Netherlands

Frans Nieuwenhout, ECN



## BACKGROUND

Major future issue in electricity grids is the integration of a large share of intermittent sources such as wind energy


Demand response is one of the potential solutions to this problem

**Intelligent E-Transport Management (ITM) project** is funded by Netherlands energy agency SenterNovem. Main objective is to assess:

- Extent with which day-night differences, stability and quality of the grid can be improved by intelligent management of electric vehicles and heat pumps;


Partners in ITM are Kema, ECN, IWO, Continuon and Essent

## Intermittent sources: 10 GW wind, realised and predicted

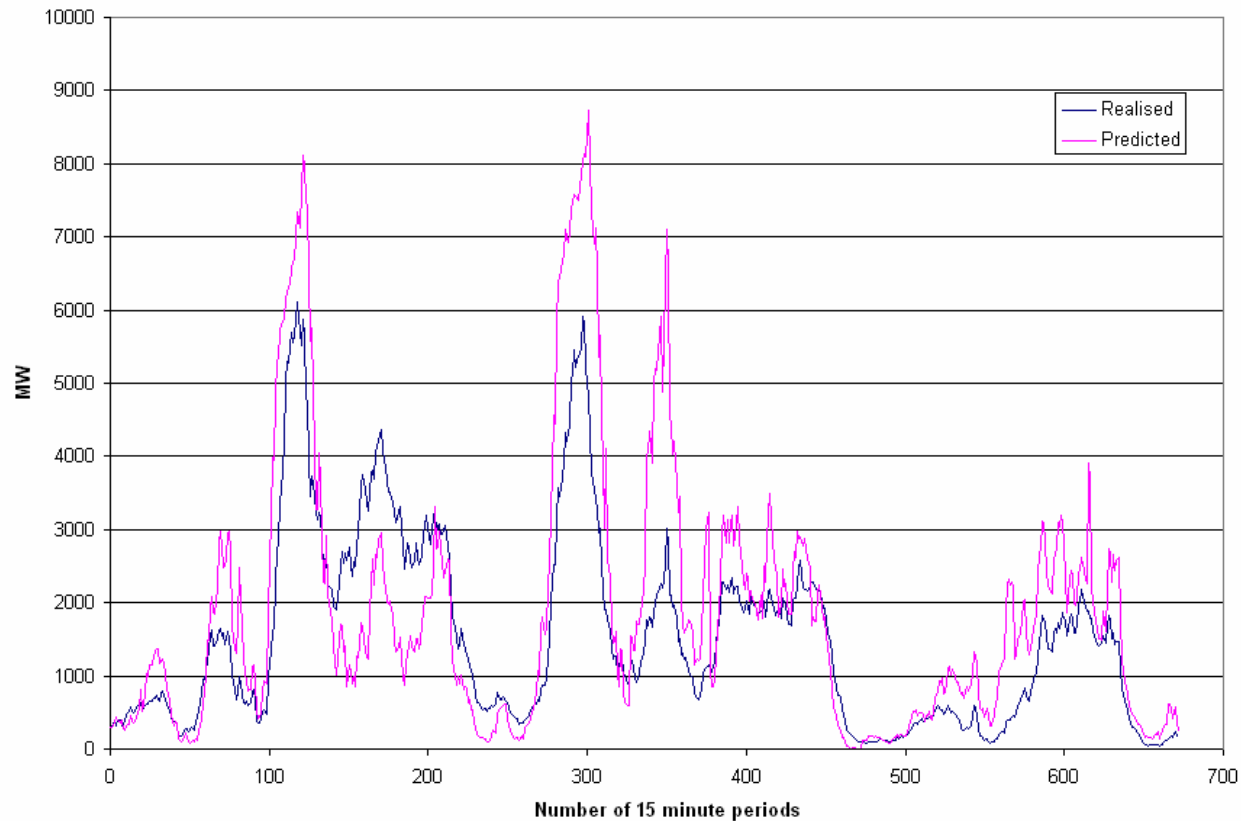

**Simulated output for a week of 6000 MW offshore and 4000 MW onshore wind**  
**Differences between predicted and realised can be thousands of MW**



## Day-night pattern total electricity demand in the Netherlands

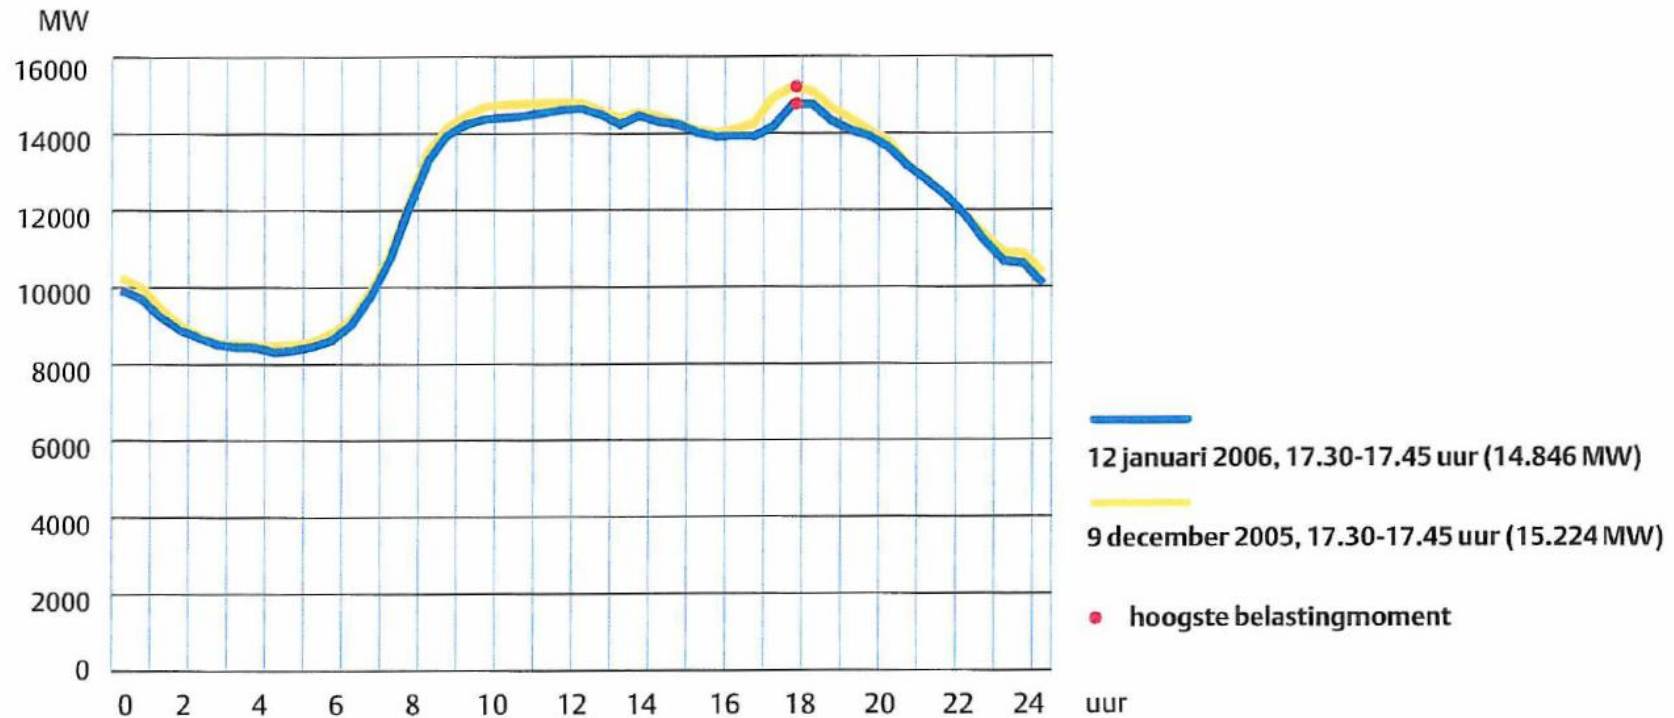



- Daily load pattern has a relatively high day-night difference compared to other European countries
- Interest from E-sector for additional electricity demand during the night hours

# Residential electricity demand profiles

Top: residential demand profile 7 days, 24 hours

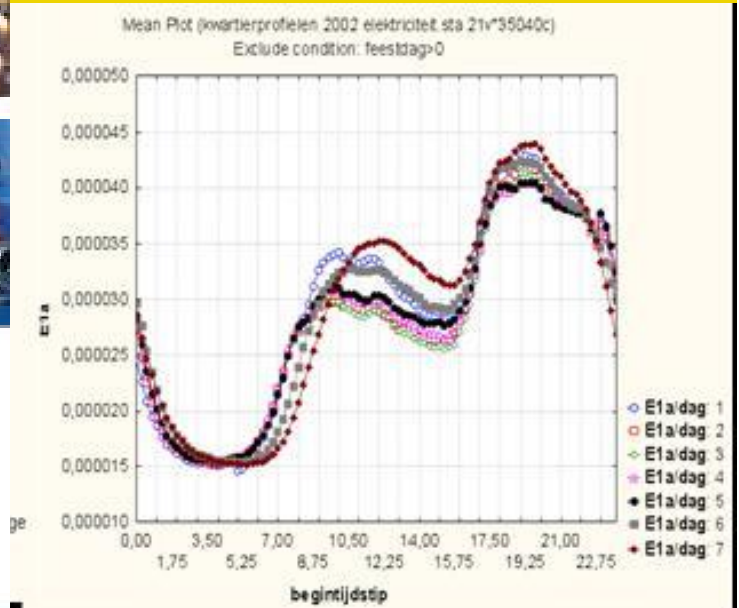

Bottom: same, but only in evening: note peak after 23h, when night tariff starts

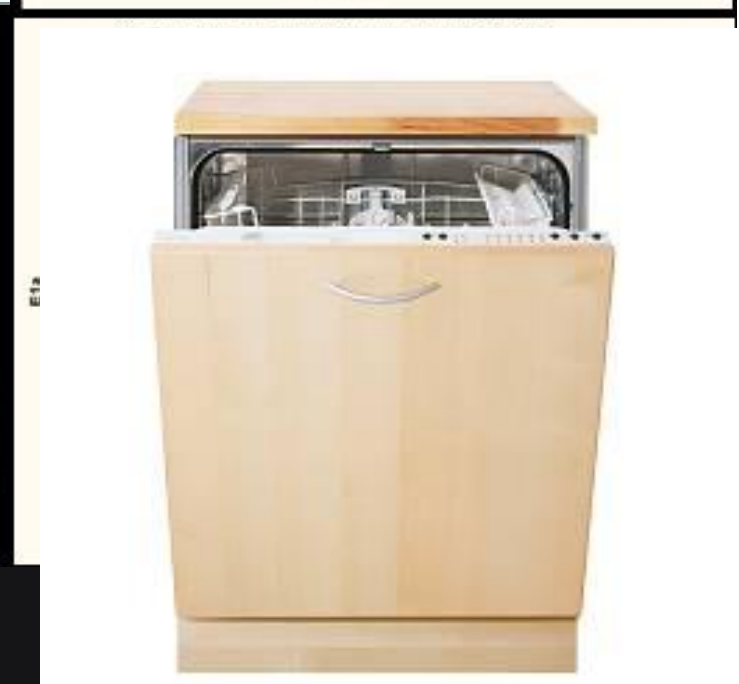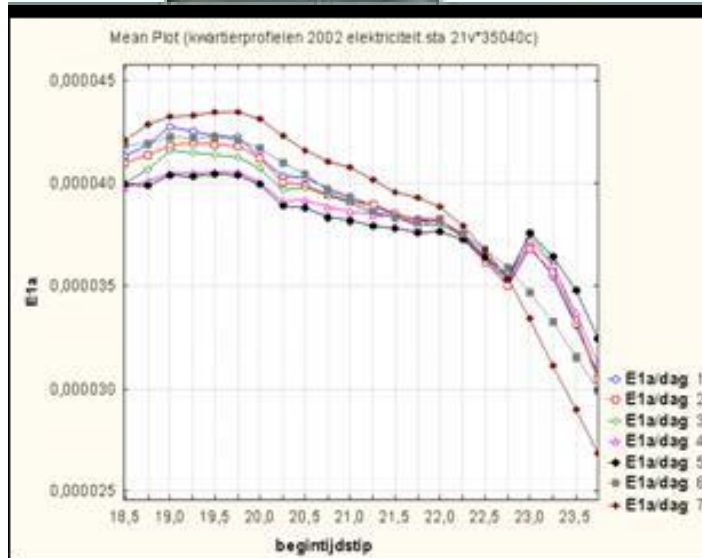

Shifting demand to night tariffs affects a few % of residential electricity demand

## Residential load shifting in the Netherlands

### Currently:

- Mainly night storage boilers, dishwashers, washing machines and dryers
- Estimated load effected: a few % of annual residential electricity consumption

### Electric appliances with a large future potential for load shifting:

- Plug-in hybrid electric vehicles
- Electric heat pumps
- Air conditioning

## Increased need for flexibility in the electricity system

Additional flexibility can be provided by four main options:

1. Improve flexibility in conventional generation: higher ramp rates; improved partial load efficiencies; choice of generation mix
2. Stronger interconnections to average out variability of intermittent sources and to match it with a larger load
3. Integrate distributed generation in electricity markets (e.g. VPP with CHP units in horticulture)
4. Demand response


Netherlands energy agency SenterNovem funded **ITM Project** deals mainly with the demand response option and focusses on two technologies:

- Plug-in hybrid electric vehicles
- Residential electric heat pumps

# PHEV and hybrid vehicle introduction scenarios from EPRI

Peak new vehicle market share in 2050 for the three PHEV adoption scenarios


2050 New Vehicle Market Share by Scenario		Vehicle Type		
		Conventional	Hybrid	Plug-In Hybrid
PHEV Fleet Penetration Scenario	Low PHEV Fleet Penetration	56%	24%	20%
	Medium PHEV Fleet Penetration	14%	24%	62%
	High PHEV Fleet Penetration	5%	15%	80%

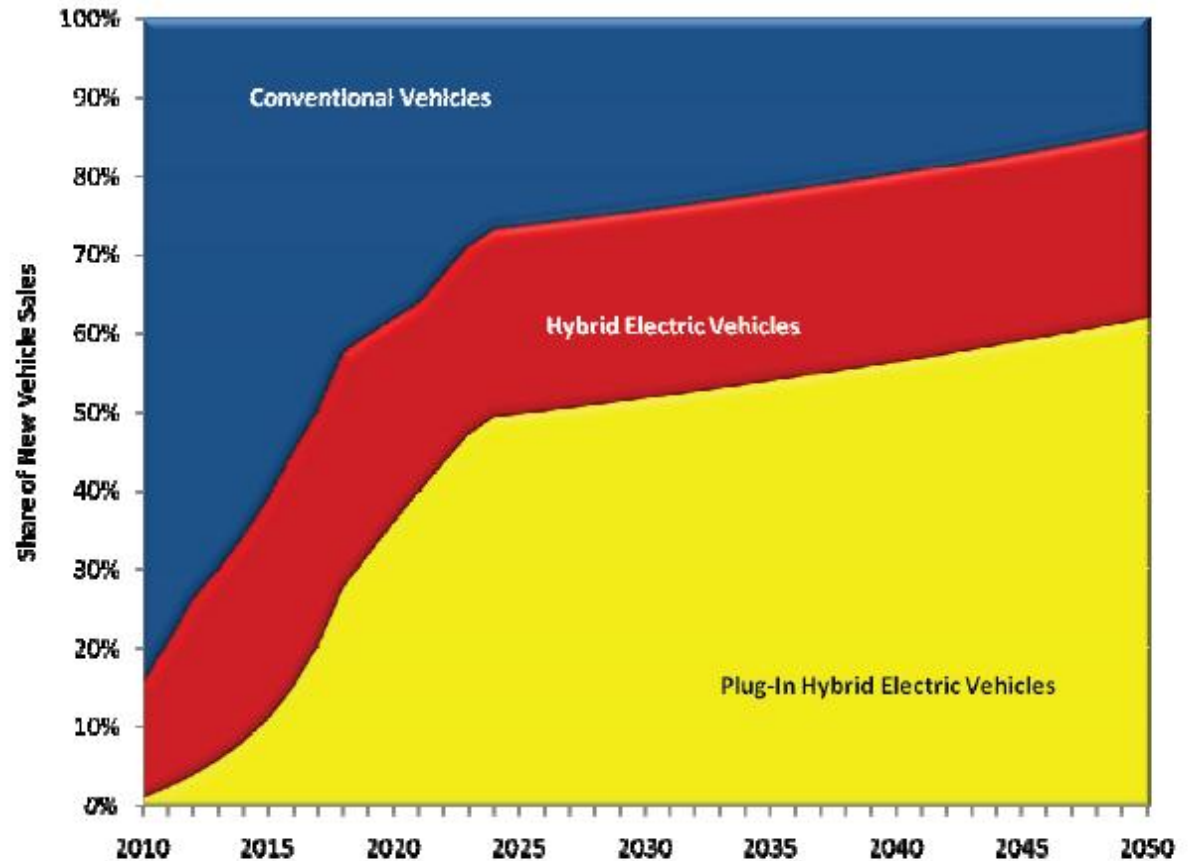

Assumed new car market share for the Medium PHEV scenario for conventional vehicles, hybrid electric vehicles, and plug-in hybrid electric vehicles for each vehicle category



## Heat pump introduction scenarios in the Netherlands

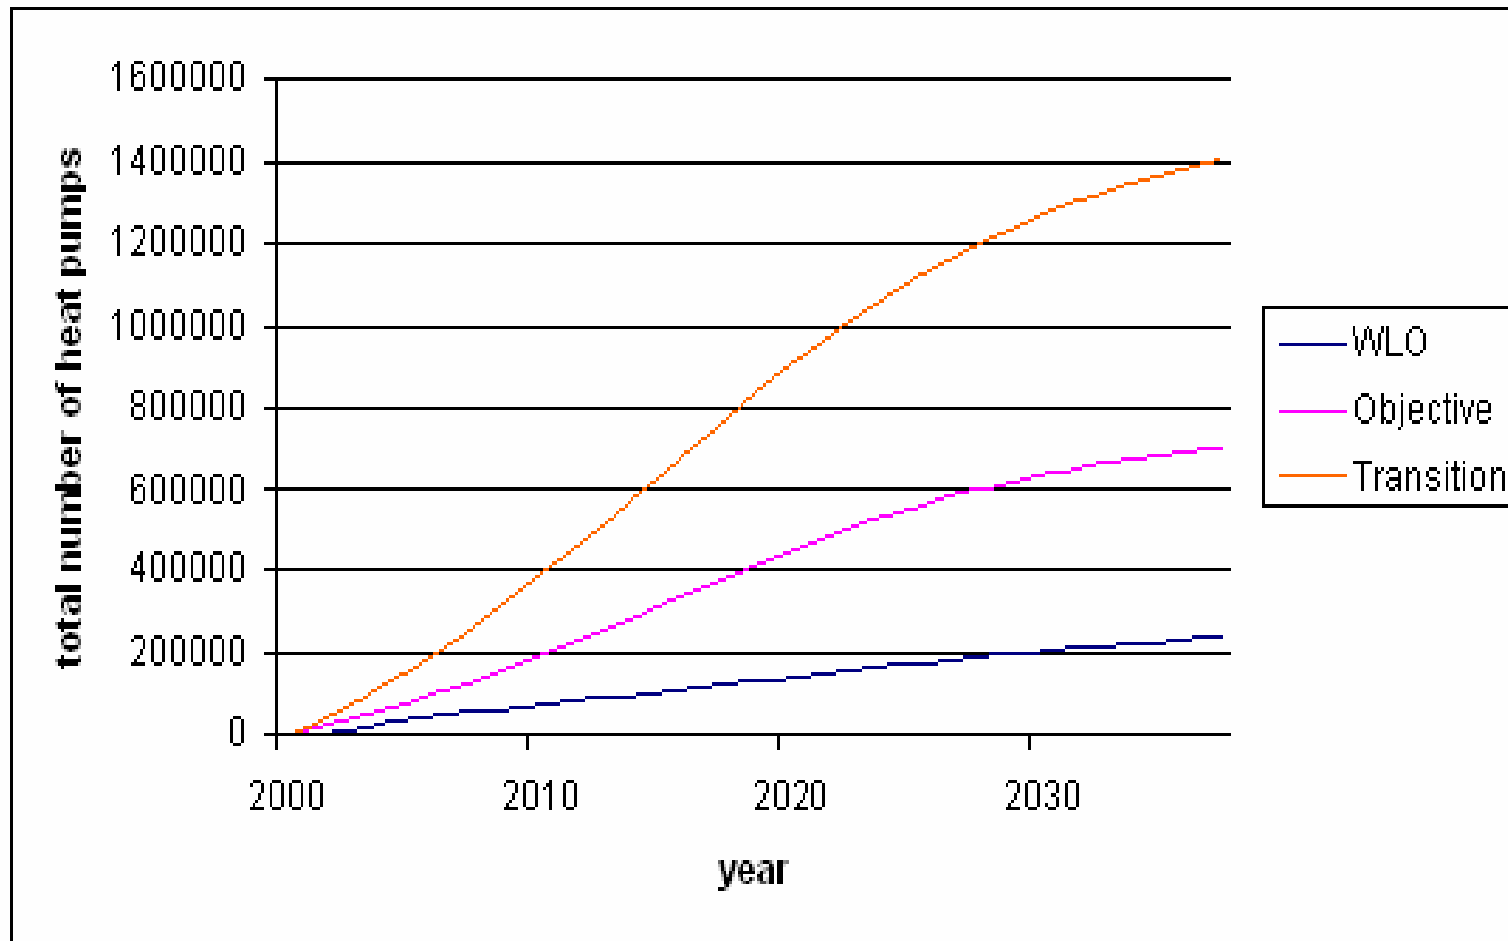


## Summary PHEV and heat pump scenarios in the Netherlands

Table 8. Summary of plug-in vehicle and heat pump scenarios

	2020	2040
Plug-in vehicles:		
#Plug-in vehicles (millions)	0.9	6.5
Total charging capacity @3kW: (GW)	2.7	6.5
Annual electricity demand (TWh/a)	2.6	19.0
Electric Heat pumps:		
# heat pumps (millions)	0.9	1.5
Total installed capacity @3kW: (GW)	2.7	4.5
Annual electricity demand (TWh/a)	3.2	5.3

Table 9. Share of plug-in vehicle and heat pump electricity demand as percentage of final electricity demand in SE scenario, and their contribution to filling the ‘night trough’

	2020	2040
Final electricity demand in SE scenario (TWh/a)	137	161
Electricity demand heat pumps + EV (TWh/a)	5.8	24.3
Heat pumps and EV as percentage of SE: (%)	4.2	15.1
Annual electricity demand to create a flat load curve (at load factor of 0.8) (TWh/a)	27	32
Heat pump and EV contribution to a flat load curve (%)	21	76

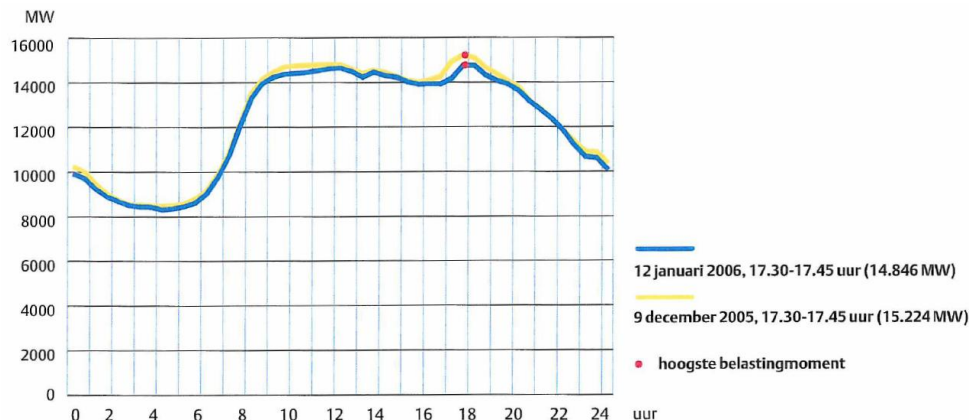

***Conclusion:*** if heat pumps and electric vehicles become popular, residential load shifting can almost completely flatten the total electricity load in the Netherlands

## Quantifying flexibility in case of residential heat pumps (1 kW) with a simple building model

Daily averages	Turning off all heat pumps = $P_{flex}$ upward	Turning on all heat pumps = $P_{flex}$ downward	Max duration $P_{flex}$ upward	Max duration $P_{flex}$ downward	$E_{flex}$	Max shift in time of $E_{flex}$
	kW	kW	h	h	kWh	h
Average summer day	0.08	0.92	3.67	0.32	0.29	3.67
Average winter day	0.26	0.74	6.40	2.28	1.68	7.79
Coldest winter day	0.69	0.31	2.45	5.36	1.68	1.78
Annual average	0.17	0.83	5.77	1.19	0.99	

## PRELIMINARY CONCLUSIONS ITM PROJECT:

- 1.5 million heat pumps (2040) can provide the equivalent of 250 MW regulating power and 1.5 GWh storage
- 6.5 million PHEV can provide 26 GWh of storage
- Together this is sufficient to compensate most of the short term differences between predicted versus realised output of 10 GW wind farms

**Residential load shifting (with plug-in hybrid electric vehicles and heat pumps) can contribute substantially to integration of intermittent renewables**